


18/03/2021



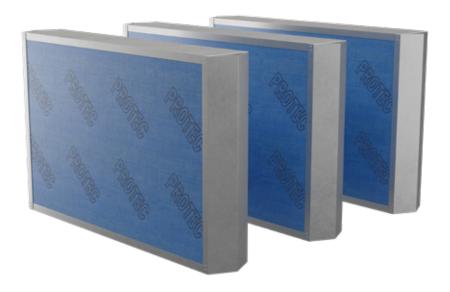

Quick facts

- Thickness 100, 200 och 300 mm
- Sizes from 300 x 300 mm to 2000 x 1800 mm
- Type approved cleanable Protec surface layer
- Can be manufactured in many special versions


Use

LFAB is designed to attenuate fan noise and air noise from e.g. dampers. The baffles are supplied with assembly profiles and are ideal for use in large, site-built silencers, in shafts or for supplementing in existing ducts. LFAB conforms to all requirements according to the current building regulations in terms of cleanability, fibre safety, emissions and microorganisms.

LFAB can be manufactured in a number of variants, the reported data is only a sample. The inlet and outlet sides of the baffles are equipped with angled profiles to limit the pressure drop. The absorption material has a type-approved surface layer that is cleanable and fibre-proof. The silencers are installed independent of the air direction. In the event of large sizes or restricted entry openings, the baffles are delivered in sections that are easily assembled on site.

For general information about silencers and technical data, see "General information about silencers" in the technical section on bevent-rasch.com


Specifications

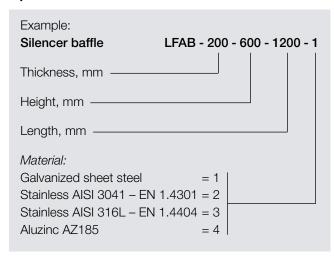

Materials and surface treatment

LFAB is manufactured as standard of galvanised sheet steel with an absorbent material of mineral wool. The baffles can also be made of stainless steel or aluzinc and with or without surface treatment. In heavily contaminated air, the baffles can be enclosed and fitted with perforated sheet.

Size and weight

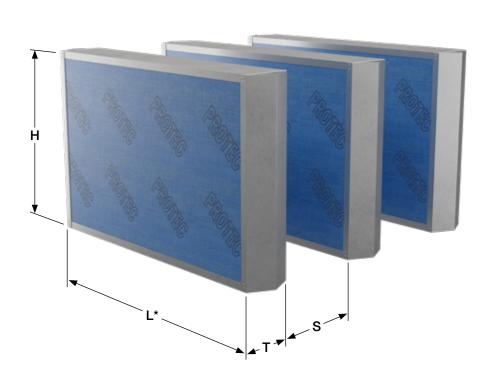

Width, height and length are freely selected according to (for standard dimensions, see table):

Thickness (T) = 100, 200, 300 mm

Height (H) = 300 - 2000 mm

Length (L) = 600 - 1800 mm. Non-reported lengths in the table 'Insertion Loss', are interpolated.

Weight/m² baffle

| Thickness, mm | 100 | 200 | 300 |
|---------------|-----|-----|-----|
| Weight, kg | 12 | 20 | 28 |

^{*} Total construction length = L + 100 mm



Selection


- 1. Select the baffle thickness and gap (T and S) for attenuation requirements and available space. Initially utilise the available length space.
- 2. Find the current flow line in the selection diagram and read the pressure drop and thickness/gap (T/S) corresponding to the current gross area.
- 3. Calculate the number of baffles relative to the size restrictions. Ideally start and finish with half baffles.

Pressure drop according to the selection diagram refers to duct-duct connected silencer regardless of length. In other installations, in terms of air direction, the pressure drop is multiplied by the following factor:

| LFAB | Type 1 | Type 2 | Type 3 | Type 4 | Type 5 | |
|-------------------|--------|--------|--------|--------|--------|--|
| Chamber - Chamber | 2,0 | 2,4 | 2,9 | 3,2 | 3,5 | |
| Duct - Chamber | 1,7 | 2,0 | 2,4 | 2,6 | 2,9 | |
| Chamber - Duct | 1,2 | 1,3 | 1,5 | 1,6 | 1,7 | |

Insertion loss

| | 1 | | | | | | | | |
|-----------|--------------|---|-----|-----|-----|----|----|----|----|
| T/S mm | Length mm | Insertion loss in octave band dB Centre frequency Hz | | | | | | | |
| | | 63 | 125 | 250 | 500 | 1K | 2K | 4K | 8K |
| 100/100 | 600 | 3 | 5 | 8 | 16 | 23 | 24 | 18 | 10 |
| | 900 | 3 | 6 | 11 | 21 | 30 | 34 | 24 | 14 |
| | 1200 | 4 | 6 | 14 | 27 | 37 | 39 | 28 | 17 |
| | 1500 | 4 | 7 | 16 | 39 | 50 | 49 | 36 | 20 |
| | 1800 | 5 | 8 | 19 | 46 | 50 | 49 | 42 | 22 |
| 200/100 | 900 | 7 | 11 | 21 | 31 | 43 | 38 | 31 | 16 |
| | 1200 | 8 | 14 | 26 | 39 | 46 | 44 | 36 | 22 |
| | 1800 | 12 | 19 | 36 | 50 | 50 | 46 | 41 | 29 |
| 200/150 | 1200 | 7 | 11 | 22 | 34 | 42 | 38 | 28 | 15 |
| | 1800 | 10 | 17 | 30 | 46 | 48 | 40 | 31 | 20 |
| 200/200 | 1200 | 6 | 8 | 17 | 26 | 35 | 30 | 16 | 9 |
| | 1800 | 7 | 12 | 25 | 39 | 44 | 34 | 19 | 11 |
| 300/100 | 900 | 11 | 17 | 29 | 42 | 50 | 49 | 33 | 18 |
| | 1200 | 13 | 20 | 33 | 45 | 50 | 50 | 35 | 20 |
| | 1500 | 14 | 24 | 38 | 47 | 50 | 50 | 40 | 23 |
| | 1800 | 16 | 27 | 44 | 50 | 50 | 50 | 45 | 24 |

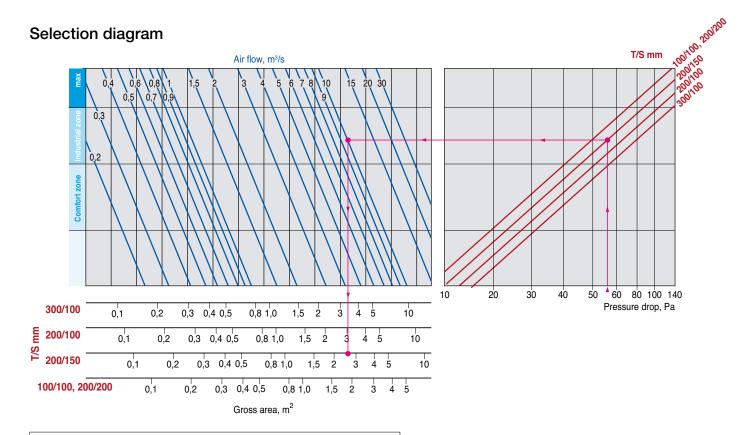

Reported work areas to the left of the selection diagram are a recommendation. For working areas reported as 'comfort zone', the inherent sound generation is generally negligible. For details of inherent sound please contact the supplier.

Selection example

Conditions:

- Air flow 10 m³/s
- Max. pressure drop 55 Pa
- Required attenuation 17 dB (250 Hz).
- Gross area 2,8 m² (B x H = 2800 x 1000 mm)

Result:

- According to the insertion loss tables and the selection diagram, the following silencers can be selected:

Thickness/Gap (T/S) = 200/150 mm

Baffle length = 1800 mm

7 baffles, T = 200 mm

2 baffles, T = 100 mm

8 baffles, S = 150 mm

